

東莞永力電業有限公司

YUNG LI CO., LTD

Da Pu Industrial Zone, Gang Zi, Changping Town,
Dong Guan City, Guangdong 523571 China.P.R.C

TEL:0769-83396797~8

FAX:0769-83396796

E-mail: sales@yung-li.com

Description: YP-03/YC-12L

Customer: MAG

Parts No. : CB-N-CH-90





Draw No. :

REVISION RECORD


1		
2		
3		
4		
5		

YUNG LI	
CHECKED	PREPARED BY

CUSTOMER	APPROVED

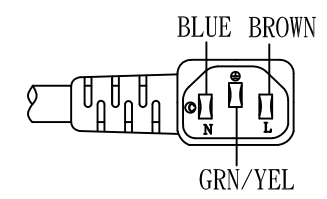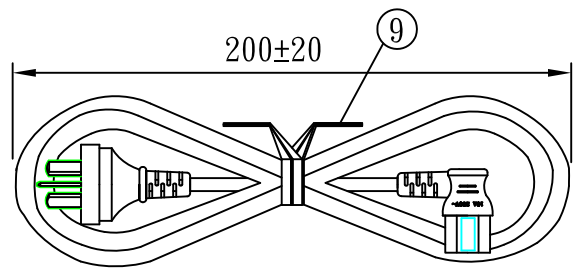
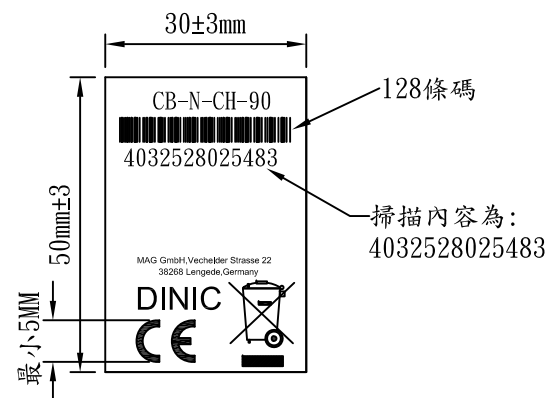
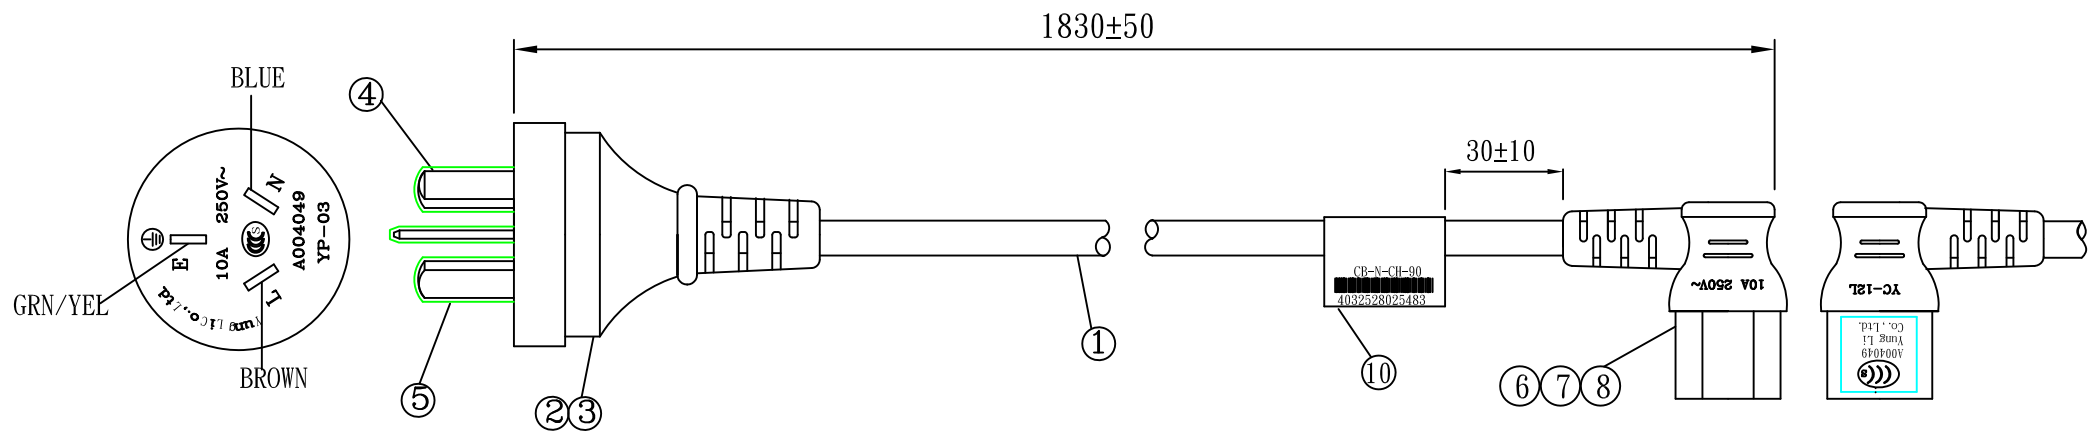


外箱標籤:每箱貼一張

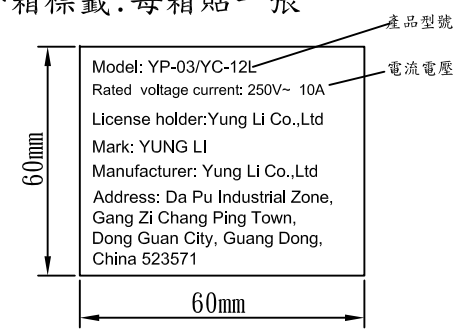

NO.	SPECIFICATION	QTY	REMARK
1	H05VV-F 0.75/3C BLACK	1PCS	
2	YP-03 PVC PLASTIC:50P BLACK	36g/PC	
3	YP-03 INNER BODY	1PC	
4	TER:98655LBS	3PCS	
5	SLEEVE:3PIN WHITE	1PC	
6	"U" TER:97740	3PCS	
7	YC-12L INNER BODY	1PC	
8	YC-12L PVC PLASTIC:50P BLACK	18g/PC	
9	MINI TIE BLACK	1PC	
10	LABEL:50*30mm 128Code	1PC	





Tolerance	Approved	Date	YUNG LI CO., LTD					
	>0±0.30	Checked	Date					
>1.0±0.50	Drawn	SUKI	Date	22.01.24	Customer	MAG		
>10.0±1.0	Cat. No.	YP-03/YC-12L		P/N.	CB-N-CH-90			
>20.0±2.0	Drawing No.	CY-C0053-03	Rev.	B	Material	P.V.C	Unit	mm
Angle: ±1°					Scale			

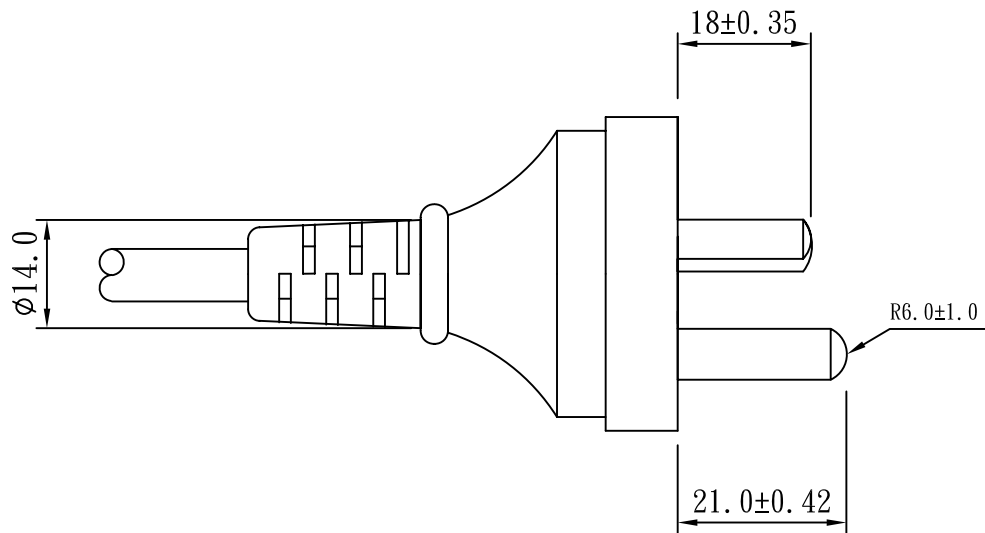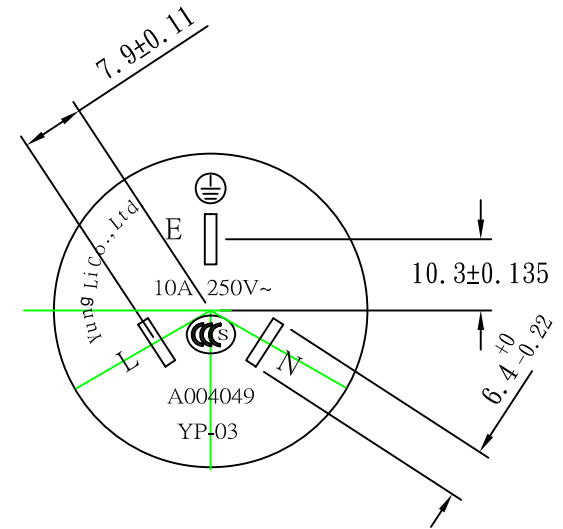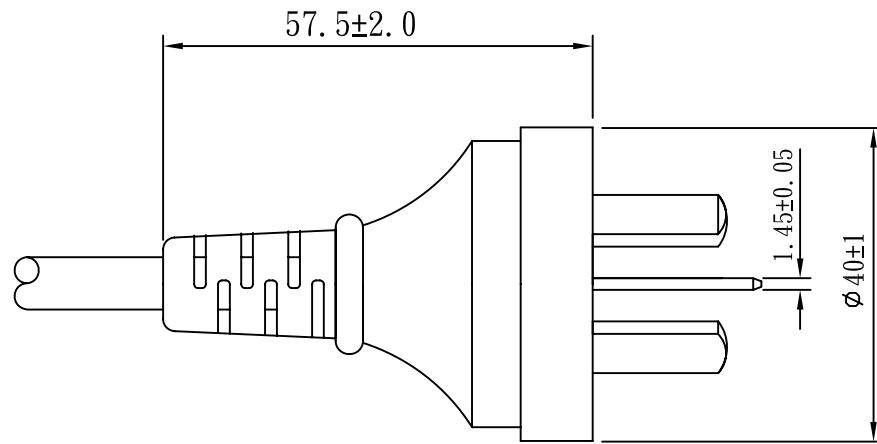

TOLERANCE >0±0.30 >1.0±0.50 >10.0±1.0 >20.0±2.0 Angle: ±1°	APPROVED	Robert	DATE	09.10.14	YUNG LI CO., LTD.			
	CHECKED		DATE					
	DRAWN	YUANJUN	DATE	09.10.14				
	TYPE	YP-03			P/N			
	DRAWING NO				MATERIAL	P.V.C	UNIT	mm
					SCALE	1:1	⊕	▭



IEC 60320 C13

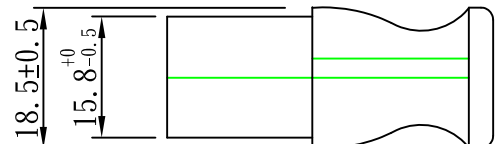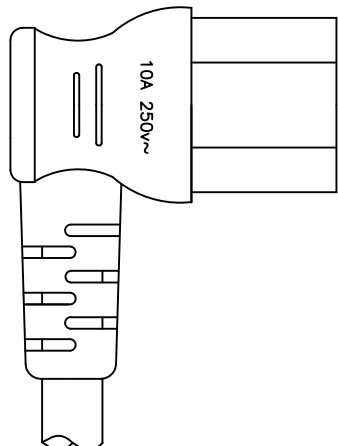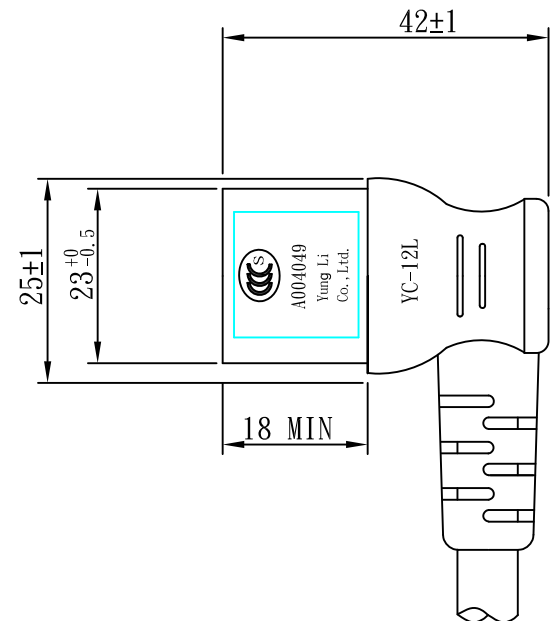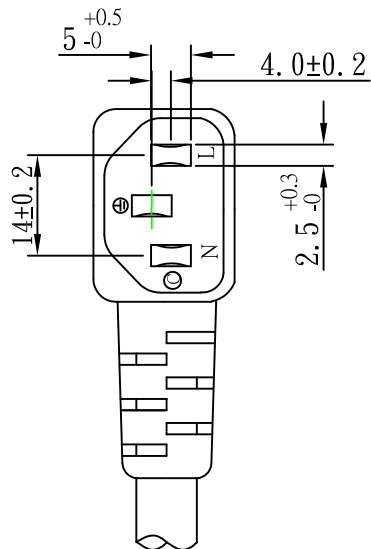

TOLERANCE >0±0.30 >1.0±0.50 >10.0±1.0 >20.0±2.0 Angle: ±1°	APPROVED		DATE		YUNG LI CO., LTD			
	CHECKED		DATE					
	DRAWN		DATE		CUSTOMER			
	TYPE	YC-12L(CCC)			P/N			
	DRAWING NO.		REV	B	MATERIAL	P. V. C	UNIT	mm
				SCALE	1:1			

YUNG LI CO., LTD










SPECIFICATION

Yung Li	Style	PVC FLEXIBLE CORDS	Document No
2019.04.23			
Edition	Size	H05VV-F 3G 0.75mm²	Page
A			1/2

1. Standard: IEC 227 IEC228
 2. Construction & Dimension

	Item	Specification
Conductor	Size	3G 0.75mm ²
	Material	Annealed Bare Copper
	Construction	24/ § 0.202±0.05
Insulation	Material	PVC
	Minimum Average Thickness	0.60mm
	Minimum Thickness at any point	0.44mm
	Diameter	2.35 ± 0.10
	Identification	Blue,Brown,Green/Yellow
Core Assembly	Core Twist	3-Core
	Filler	NA
	Assembly Pair	NA
Taping	Mylar Foil	NA
Shielded	A1-Mylar Foil	NA
Drain	Material	NA
	Construction	NA
Jacket	Material	PVC
	Minimum Average Thickness	0.8mm
	Minimum Thickness at any point	0.58mm
	Overall Diameter(Approx)	6.7 ± 0.2
	Color	Any Color

Marking:

Yung Li Co., Ltd. H05VV-F 3G 0.75mm² <VDE> NF-USE 1347  KEMA-KEUR  CEBEC <OVE>
     IEMMEQU SAA-190646-EA  A004049 60227 IEC 53(RVV) 300/500V  SU01027-4002

YUNG LI CO., LTD


SPECIFICATION


Yung Li	Style	PVC FLEXIBLE CORDS	Document No
2019.04.23			
Edition	Size	H05VV-F 3G 0.75mm²	Page
A			2/2

4. Electrical & Physical Properties

Item	Specification		
Rating Voltage	70°C 300/500V		
Conductor resistance(AT 20°C)	26.0Ω/Km MAX		
Insulation Resistance(AT 70°C)	0.011MΩ/Km Min		
Dielectric Strength	AC 2.0 KV / 15 min No Break		
Spark Test	6.0KV		
Insulation	Unaged	Tensile Strength	1.02 kgf/mm ² min
		Elongation	150% Min
	Aged	Tensile Strength	80~120% (80°C x168hrs)
		Elongation	80~120% (80°C x168hrs)
	Loss of mass Test		2.0mg/cm ² (max)
	Jacket	Unaged	Tensile Strength
Elongation			150% Min
Aged		Tensile Strength	80~120% (80°C x168hrs)
		Elongation	80~120% (80°C x168hrs)
Loss of mass Test		2.0mg/cm ² (max)	
Deformation Test		70±2°C X 4hr ≤ 50%	
Cold Bend Test		-15°C x 1hr No Crack	
Heat Shock Test		150±2°C x 1hr No Crack	

Graph:

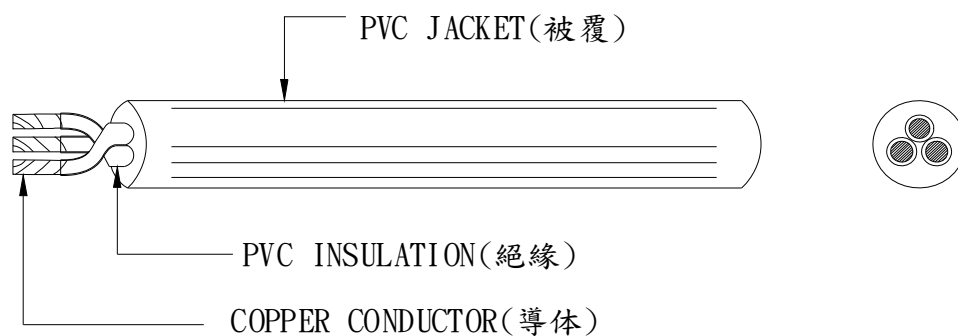



CERTIFICATE FOR CHINA COMPULSORY PRODUCT CERTIFICATION

CERTIFICATE NO.: 2007010101249051

NAME AND ADDRESS OF THE APPLICANT

Yung Li Co.,Ltd.

Dapu Industrial Zone, Gangzi, Changping Town, Dongguan

NAME AND ADDRESS OF THE MANUFACTURER

Yung Li Co.,Ltd.

Dapu Industrial Zone, Gangzi, Changping Town, Dongguan

NAME AND ADDRESS OF THE FACTORY

Yung Li Co.,Ltd.

Dapu Industrial Zone, Gangzi, Changping Town, Dongguan

PRODUCT NAME, MODEL AND SPECIFICATION

Cord Set

YP-03+YC-12、YP-03 + YC-12L、YP-03L + YC-12、YP-03L + YC-12L 10A 250V~(配 60227IEC53 3×0.75mm²、60227IEC53 3×1mm²)、YP-03 + YC-12L-1、YP-03 + YC-12L-2、YP-03 + YC-12L-3、YP-03L + YC-12L-1、YP-03L + YC-12L-2、YP-03L + YC-12L-3 10A 250V ~ (配 60227IEC53 3×0.75mm²、60227IEC53 3×1mm²、60227IEC53 3×1.5mm²)

THE STANDARDS AND TECHNICAL REQUIREMENTS FOR THE PRODUCTS

GB/T15934-2008

This is to certify that the above mentioned product(s) complies with the requirements of implementation rules for compulsory certification(REFNO.CNCA-C02-01:2014).

Valid from: Oct.10,2018

Valid until: Oct.10,2023

The validity of the certificate is subject to positive result of the regular follow up inspection by issuing certification body until the expiry date.

Date of original issued: Sep.27,2007

The certificate information is available through CNCA's website: www.cnca.gov.cn




President:

Wang Kejiao



CHINA QUALITY CERTIFICATION CENTRE



CERTIFICATE FOR CHINA COMPULSORY PRODUCT CERTIFICATION

CERTIFICATE NO.: 2004010105138414

NAME AND ADDRESS OF THE APPLICANT

Yung Li Co.,Ltd.
Dapu Industrial Zone,Gangzi,Changping Town,Dongguan

NAME AND ADDRESS OF THE MANUFACTURER

Yung Li Co.,Ltd.
Dapu Industrial Zone,Gangzi,Changping Town,Dongguan

NAME AND ADDRESS OF THE FACTORY

Yung Li Co.,Ltd.
Dapu Industrial Zone,Gangzi,Changping Town,Dongguan

PRODUCT NAME, MODEL AND SPECIFICATION

PVC insulated flexible cables and wires
60227 IEC 52(RVV) 300/300V 0.5-0.75(2-3 芯); 60227 IEC 53(RVV) 300/500V 0.75-2.5(2-5 芯);

THE STANDARDS AND TECHNICAL REQUIREMENTS FOR THE PRODUCTS

GB/T 5023.5-2008/IEC60227-5:2003

This is to certify that the above mentioned product(s) complies with the requirements of implementation rules for compulsory certification(REFNO.CNCA-C01-01:2014).

Valid from: Nov.20,2020

Valid until: Nov.20,2025

The validity of the certificate is subject to positive result of the regular follow up inspection by issuing certification body until the expiry date.

Date of original issued: Jan.04,2005

The certificate information is available through CNCA's website: www.cnca.gov.cn

Accredited by China National Accreditation Service for Conformity Assessment, CNAS004



President:

Lu Mei



CHINA QUALITY CERTIFICATION CENTRE



中国国家强制性产品认证证书

证书编号：2007010101249051

委托人名称、地址

东莞永力电业有限公司
东莞市常平镇岗梓大埔工业区

生产者（制造商）名称、地址

东莞永力电业有限公司
东莞市常平镇岗梓大埔工业区

生产企业名称、地址

东莞永力电业有限公司
东莞市常平镇岗梓大埔工业区

产品名称和系列、规格、型号

电线组件

YP-03+YC-12、YP-03 + YC-12L、YP-03L + YC-12、YP-03L + YC-12L 10A 250V~(配 60227IEC53 3×0.75mm²、60227IEC53 3×1mm²)、YP-03 + YC-12L-1、YP-03 + YC-12L-2、YP-03 + YC-12L-3、YP-03L + YC-12L-1、YP-03L + YC-12L-2、YP-03L + YC-12L-3 10A 250V ~ (配 60227IEC53 3×0.75mm²、60227IEC53 3×1mm²、60227IEC53 3×1.5mm²)

产品标准和技术要求

GB/T15934-2008

上述产品符合强制性产品认证实施规则 CNCA-G02-01:2014 的要求，特发此证。

发证日期：2018 年 10 月 10 日 有效期至：2023 年 10 月 10 日

证书有效期内本证书的有效性依据发证机构的定期监督获得保持。

本证书为变更证书，证书首次颁发日期：2007 年 09 月 27 日


本证书的相关信息可通过国家认监委网站 www.cnca.gov.cn 查询



主任：



中国质量认证中心



中国国家强制性产品认证证书

证书编号：2004010105138414

委托人名称、地址

东莞永力电业有限公司
广东省东莞市常平镇岗梓大埔工业区

生产者（制造商）名称、地址

东莞永力电业有限公司
广东省东莞市常平镇岗梓大埔工业区

生产企业名称、地址

东莞永力电业有限公司
广东省东莞市常平镇岗梓大埔工业区

产品名称和系列、规格、型号

聚氯乙烯绝缘电缆电线

60227 IEC 52(RVV) 300/300V 0.5-0.75(2-3 芯); 60227 IEC 53(RVV) 300/500V 0.75-2.5(2-5 芯);

产品标准和技术要求

GB/T 5023.5-2008/IEC60227-5:2003

上述产品符合强制性产品认证实施规则 CNCA-C01-01:2014 的要求，特发此证。

发证日期：2020 年 11 月 20 日 有效期至：2025 年 11 月 20 日

证书有效期内本证书的有效性依据发证机构的定期监督获得保持。

本证书为变更证书，证书首次颁发日期：2005 年 01 月 04 日

本证书的相关信息可通过国家认监委网站 www.cnca.gov.cn 查询
经中国合格评定国家认可委员会认可 CNAS C001-P



主任：

陆楠



中国质量认证中心