

STOCK CODE

EL182S

ITF-14
Barcode **05055112814965**

CABLE REQUIREMENTS:

Make:

Colour: BLACK

Type:

3 CORE 1.00mm² H05 VV-F

PLUG REQUIREMENTS:

Type: SW102

Colour: BLACK

Rating: 16A

Reference: R/A Schuko


CONNECTOR REQUIREMENTS:

Type: SW905

Colour: BLACK

Rating: 10A

Other Information:
C13 IEC Locking Connector

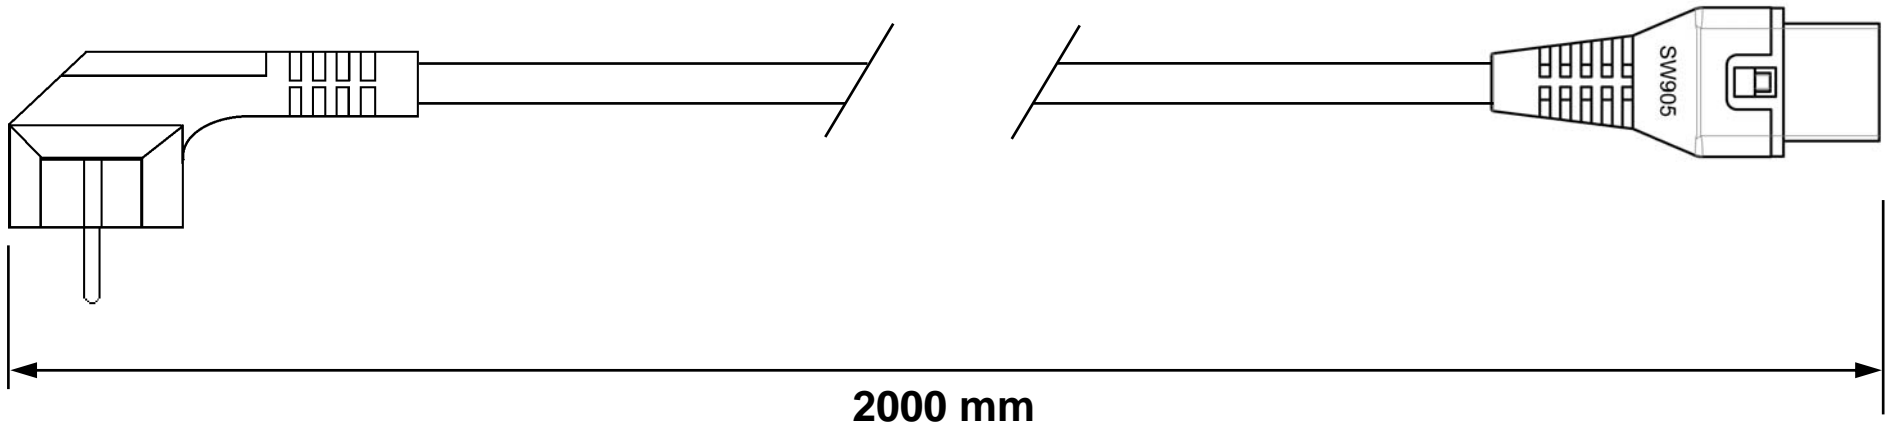

EXTRA REQUIREMENTS

PACKAGING OUTER	100
PIN PROTECTING COVER	NO
WIRING INSTRUCTIONS	NO
NO COVER OVER RED SLIDE	

HANKING

DRAWING

None

TERMINATION DETAILS		
LIVE / BROWN	NEUTRAL / BLUE	EARTH / GREEN & YELL
Type: Not Required Size:	Type: Not Required Size:	Type: Not Required Size:

OTHER COMMENTS

CERTIFICATE

Issued to:
Applicant:
Scolmore International Ltd.
1 Scolmore Park, Landsberg,
Staffordshire B79 7xb, Great Britain

Manufacturer/Licensee:
Scolmore International Ltd.
1 Scolmore Park, Landsberg,
Staffordshire B79 7xb, Great Britain

Product(s) : appliance connectors; (2-pole)
Trade name(s) : IEC-LOCK.COM
Type(s)/model(s) : SW905

The product and any acceptable variation thereto is specified in the Annex to this certificate and the documents therein referred to.

DEKRA hereby declares that the above-mentioned product has been certified on the basis of:

- a type test according to the standard EN 60320-1:2001 + A1: 2007
- an inspection of the production location according to CENELEC Operational Document CIG 021
- a certification agreement with the number 2144780

DEKRA hereby grants the right to use the KEMA-KEUR certification mark.

The KEMA-KEUR certification mark may be applied to the product as specified in this certificate for the duration of the KEMA-KEUR certification agreement and under the conditions of the KEMA-KEUR certification agreement.

This certificate is issued on: 7 November 2011 and expires upon withdrawal of one of the above mentioned standards.

Certificate number: 2144655.02

DEKRA Certification B.V.



drs. G.J. Zoetbrood
Managing Director



H.L. Schendstok
Certification Manager

© Integral publication of this certificate is allowed

All testing, inspection, auditing and certification activities of the former KEMA Quality are an integral part of the DEKRA Certification Group.

ACCREDITED BY
THE DUTCH COUNCIL
FOR ACCREDITATION



SPECIFICATION OF THE CERTIFIED PRODUCT**Product data**

product	:	appliance connectors; (2-pole)
trade name	:	IEC-LOCK.COM
type	:	SW905
rated current	:	10 A
rated voltage	:	250 V~
standard sheet	:	C13
temperature limit	:	T70
earthing	:	with earthing contact
design	:	non-rewirable
applied flexible cord	:	H05VV-F 3G1,0 mm ² H05RN-F 3G0,75 and 3G1,0 mm ²
certification mark	:	complies with the requirements
cord termination	:	crimped connection
description	:	body of thermoplastic material as part of an incomplete cord set for class I appliances, provided with an internal lock
markings	:	are shown on the body

TESTS**Test requirements**

EN 60320-1:2001 + A1:2007

Test result

The test results are laid down in DEKRA test file 2144655.02.

Remarks



This certificate replaces our certificate 2144655.01 dated 2011-09-09 and is also partly based on the results of that certificate.

Conclusion

The examination proved that all test requirements were met.

Tested by : Tommy Cai

Checked by : H.R.M. Barends


**Factory locations**

Hangzhou Hongshi Electrical Ltd.

#28 Xinqiao Xin Road, Gaoqiao Industrial Zone, Fuyang 311402, Hangzhou, Zhejiang Province

China

ZEICHENGENEHMIGUNG MARKS APPROVAL

Scolmore International Ltd.
1 Scolmore Park, Landsberg
Lichfield Road Industrial Estate
TAMWORTH
Staffordshire B79 7XB
UNITED KINGDOM

ist berechtigt, für ihr Produkt /
is authorized to use for their product


Stecker mit Schutzkontakt, nicht wiederanschließbar, umspritzt
Plug, with earthing contact, non-rewirable, moulded

die hier abgebildeten markenrechtlich geschützten Zeichen
für die ab Blatt 2 aufgeführten Typen zu benutzen /
the legally protected Marks as shown below for the types referred to on page 2 ff.



Geprüft und zertifiziert nach /
Tested and certified according to

DIN VDE 0620-1 (VDE 0620-1):2010-02

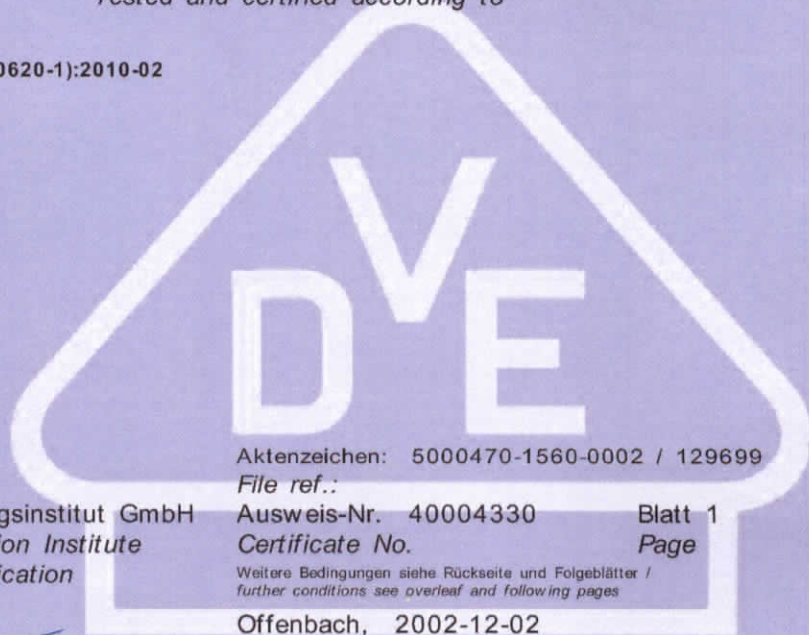

VDE Prüf- und Zertifizierungsinstitut GmbH
VDE Testing and Certification Institute
Zertifizierungsstelle / Certification

VDE Zertifikate sind nur gültig bei Veröffentlichung unter:
VDE certificates are valid only when published on:

Aktenzeichen: 5000470-1560-0002 / 129699

File ref.:

Ausweis-Nr. 40004330

Blatt 1

Certificate No.

Page

Weitere Bedingungen siehe Rückseite und Folgeblätter /
further conditions see overleaf and following pages

Offenbach, 2002-12-02

(letzte Änderung/updated 2010-10-06)

<http://www.vde.com/zertifikat>

<http://www.vde.com/certificate>

Name und Sitz des Genehmigungs-Inhabers / *Name and registered seat of the Certificate holder*
Scolmore International Ltd., 1 Scolmore Park, Landsberg, Lichfield Road Industrial Estate,
TAMWORTH, Staffordshire, B79 7XB, UNITED KINGDOM

Aktenzeichen / *File ref.*
5000470-1560-0002 / 129699 / FG45 / SHA

letzte Änderung / *updated* Datum / *Date*
2010-10-06 2002-12-02

Dieses Blatt gilt nur in Verbindung mit Blatt 1 des Zeichengenehmigungsausweises Nr. 40004330.
This supplement is only valid in conjunction with page 1 of the Certificate No. 40004330.

Stecker mit Schutzkontakt, nicht wiederanschließbar, umspritzt
Plug, with earthing contact, non-rewirable, moulded

Typ(en) / *Type(s)*:

SW102

Bemessungsspannung <i>Rated voltage</i>	AC 250 V
Bemessungsstrom <i>Rated current</i>	16 A
Polzahl <i>Number of poles</i>	2-polig mit zwei Schutzkontaktsystemen <i>2-pole with dual earthing contact system</i>
Bauart <i>Kind of construction</i>	Normblatt: DIN 49441-R2 <i>standard sheet: DIN 49441-R2</i>
Schutzart <i>Degree of protection</i>	IP20
Produktinformation <i>Product information</i>	siehe Anlage Nr. 400A, 900A <i>see Appendix No. 400A, 900A</i>

VDE Prüf- und Zertifizierungsinstitut GmbH
VDE Testing and Certification Institute
Fachgebiet FG45
Section FG45